RECTORSEAL

A CSW Industrials Company

PRODUCT DATA SHEET

OUTSET™ SEAL

Adjustable Lineset Outlet



Description

Outset™ Seal protects indoor spaces by preventing air leakage, moisture, pest intrusion, and wall penetration where the lineset exits the structure.

It supports refrigerant linesets for both ducted and ductless HVAC systems. Panel size accommodates linesets with an outer diameter of up to ⅞" and ¾" insulation.

Suitable for new installations and retrofit projects.

Parts List

Model 82001 - Horizontal:

1. Top Panel, wall gasket with flexible sleeve
2. Bottom Panel, wall gasket
3. 4x Hex head, anti-corrosion, self-tapping screw, with pre-mounted washer
4. 1x Anti-corrosion, self-tapping screw
5. 3x Zip ties

Model 82000 - Vertical:

1. Left Panel, wall gasket with flexible sleeve
2. Right Panel, wall gasket
3. 4x Hex head, anti-corrosion, self-tapping screw, with pre-mounted washer
4. 2x Anti-corrosion, self-tapping screw
5. 3x Zip ties

Features

- Suitable for new installation or retrofit projects
- Simple and quick to install with hinge-style closure
- Three size guidelines ensure precise, straight cuts
- 3/4" foam gasket standard
- UV and weather-resistant
- Suitable for painting

Applications

Adjustable wall seal for central and mini-split systems.
Used for both new and existing installations.


Packaging

Code	Description	Qty. per Case	Lbs. per Case	Cubic Ft per Case
82000	Vertical Adjustable Lineset Outlet	4	4.5	1.57
82001	Horizontal Adjustable Lineset Outlet	4	5.85	0.95


Installation instructions

MODEL 82000 VERTICAL

1. Assemble the left and right panel together.

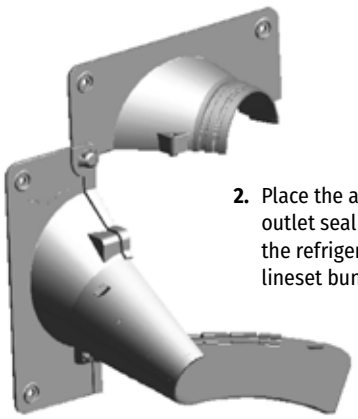

2. Place the assembled outlet seal around the refrigerant lineset bundle.

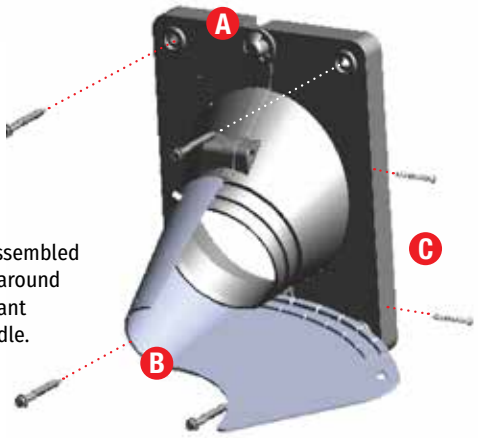


3. Close the left and right panel, as shown in **A**.
4. Wrap the flexible sleeve around the lineset bundle and lock it in place, as shown in **B**. Follow the guidelines on the sleeve to cut for different lineset sizes.
5. Install the 2x screws to bond the left and right panels, as shown in **C**.
6. Install the 4x screws to fix the panels to the wall, as shown in **D**.




7. Use the zip ties to tie the flexible sleeve around the lineset bundle, as shown in **E**.

MODEL 82001 HORIZONTAL


1. Assemble the left and right panel together.

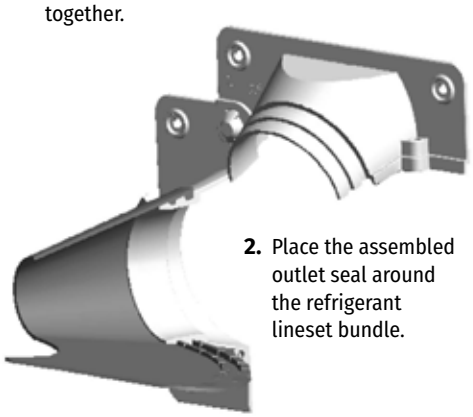

2. Place the assembled outlet seal around the refrigerant lineset bundle.

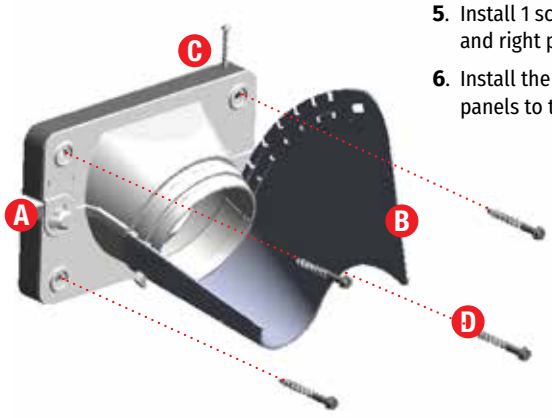

3. Close the left and right panel, as shown in **A**.
4. Wrap the flexible sleeve around the lineset bundle and lock it in place, as shown in **B**. Follow the guidelines on the sleeve to cut for different lineset sizes.
5. Install 1 screw to bond the left and right panels, as shown in **C**.
6. Install the 4x screws to fix the panels to the wall, as shown in **D**.

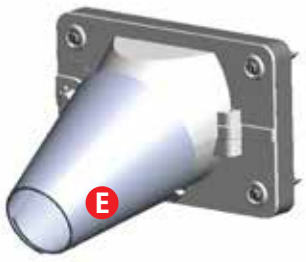

7. Use the zip ties to tie the flexible sleeve around the lineset bundle, as shown in **E**.

Limited Warranty

3YR LIMITED WARRANTY

For more information on our product limited warranty, visit RectorSeal.com

Manufactured by

RectorSeal, LLC

2601 Spenwick Drive • Houston, TX 77055, USA • 800-231-3345 • Fax 800-441-0051 • rectorseal.com

3255 Wyandotte St. East, Windsor, ON N8Y 1E9, Canada 519-966-4901

A CSW Industrials Company. RectorSeal, the logos and other trademarks are property of RectorSeal, LLC, its affiliates or its licensor's and are protected by copyright, trademark and other intellectual property laws, and may not be used without permission. RectorSeal reserves the right to change specifications without prior notice. ©2025 RectorSeal. All rights reserved. R50770-0825